


TOUCH READ COMPOUND OR TURBO METER W/STRAINER BY CONTRACTOR

VALVE VAULT COVERS SHALL BE ALUMINUM WITH 316 S.S. HARDWARE, VAULT COVER ASSEMBLIES WEIGHING IN EXCESS OF 100 LBS. SHALL BE FABRICATED IN SECTIONS FOR EASIER REMOVAL.

NOTE:
 ALL D.I. PIPE, VALVES, ETC. SHALL BE PAINTED WITH 2 (TWO) COATS OF BLUE ENAMEL PAINT.
 DETAIL TO ONLY BE USED IF BACKFLOW IS IN A REMOTE LOCATION.

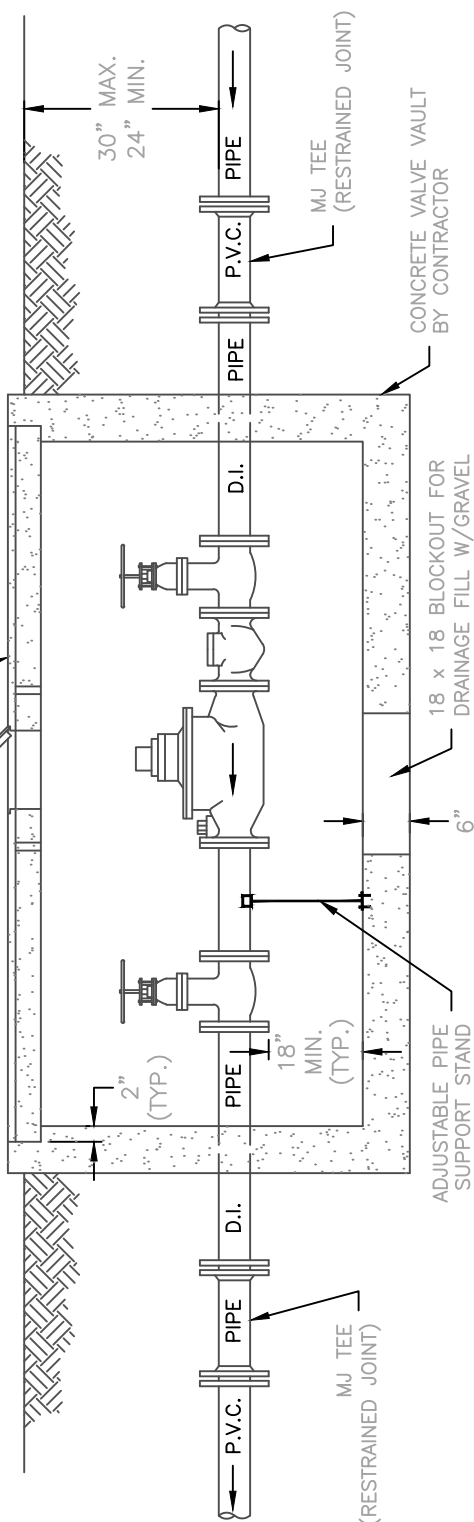

WATER METER DETAIL W/ BYPASS
 NOT TO SCALE

REV	DATE	BY	REVISIONS



WATER METER
DETAIL W/ BYPASS
TECHNICAL STANDARDS MANUAL
 CITY OF LYNN HAVEN FLORIDA

CAD FILE:	WATER
DWN BY:	REF
DATE:	30 APR 07
SHEET NO:	18 OF 27
DETAIL	W-18