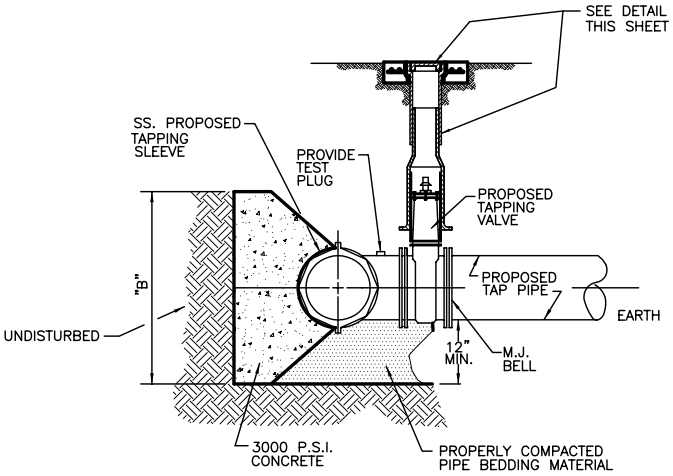

SECTION A–A

FOR DIMENSIONS "B" AND "d" SEE THRUST BLOCK DETAILS

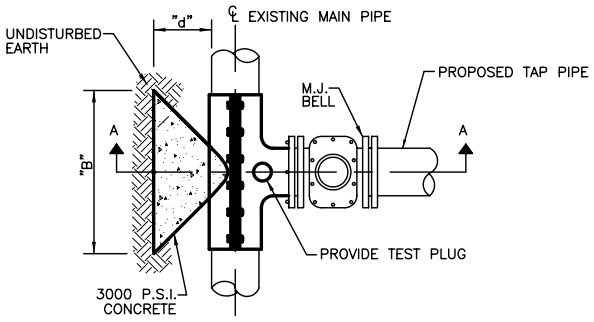

PLAN

NOTES:

1.) NO CUTS SHALL BE MADE BEFORE:
- (A) A TEST OF 180 OR 200 P.S.I. FOR 60 MINUTES IS MADE.
- (B) ALL FITTINGS TO BE WRAPPED WITH 20 MIL VISQUEEN AT THRUST BLOCK
- (C) ALL TAPS TO BE MADE BY THE CONTRACTOR AND MATERIAL TO BE FURNISHED BY THE CONTRACTOR

2.) ALL TAPS MUST BE OF A SMALLER SIZE THAN THE MAIN BEING TAPPED & PLACED NO CLOSER THAN 30" OR A DISTANCE EQUAL TO (1) MAIN PIPE DIAMETER PLUS (2) TAP PIPE DIAMETERS (WHICHEVER IS LARGER) FROM A JOINT OR FITTING.

TAPPING SLEEVE & VALVE BLOCKING DETAIL

NOT TO SCALE

© CITY OF LYNN HAVEN ALL RIGHTS RESERVED. NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR UTILIZED IN ANY FORM WITHOUT PRIOR WRITTEN AUTHORIZATION OF THE CITY OF LYNN HAVEN.

TECHNICAL STANDARDS MANUAL

TAPPING SLEEVE AND VALVE BLOCKING DETAIL
TECHNICAL STANDARDS MANUAL
CITY OF LYNN HAVEN FLORIDA

CAD FILE:	TSAVBD
DWN BY:	JEH
DATE:	30 APR 07
SHEET NO:	10 OF 26
DETAIL	W-10

Date: Apr 30, 2007, 2:34pm User ID: JEHfile: P:\14340 Comp Plan\Drawings\REVISIONS INFO\WATER.dwg